



Pool Length and Depths.
Width - 4m

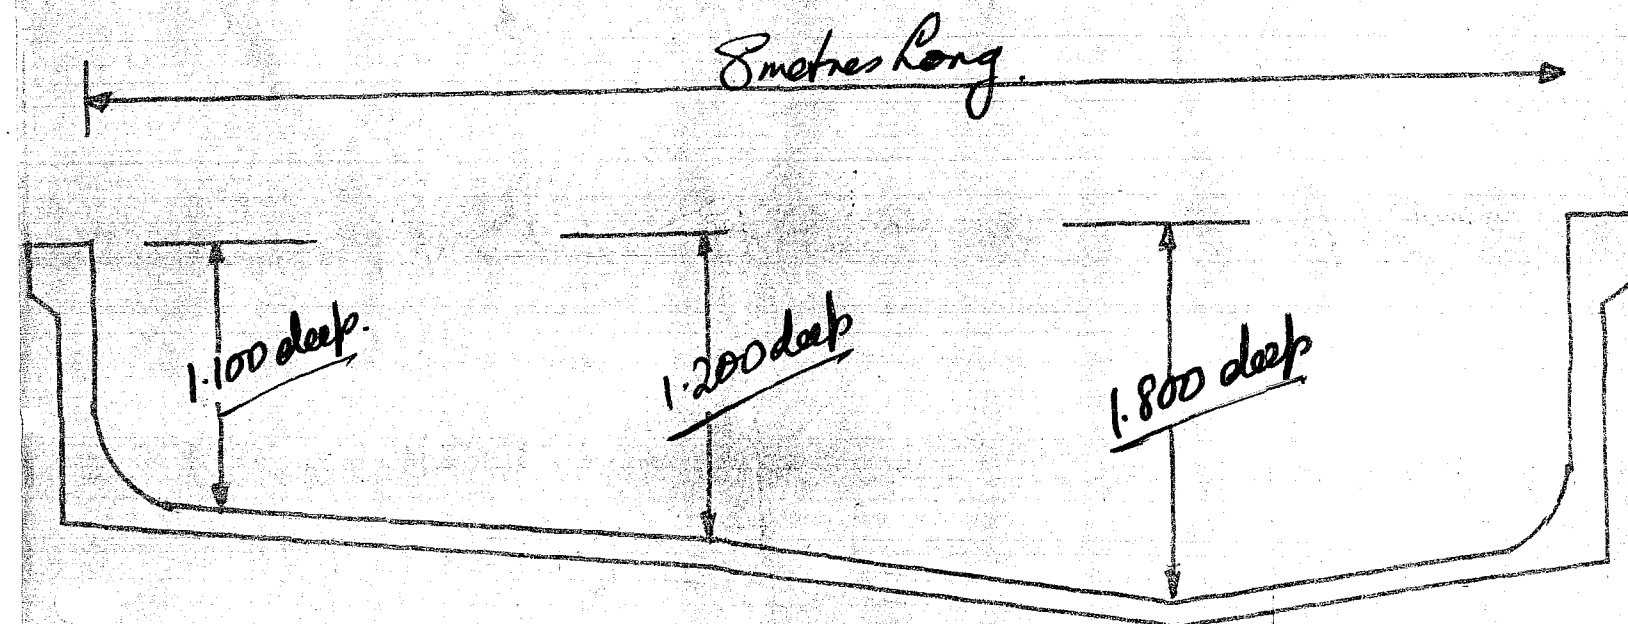

Reinforcing.

10mm Steel shown only. 665 mesh over top.
Steel doubled vertically where wall over 1.20m high.

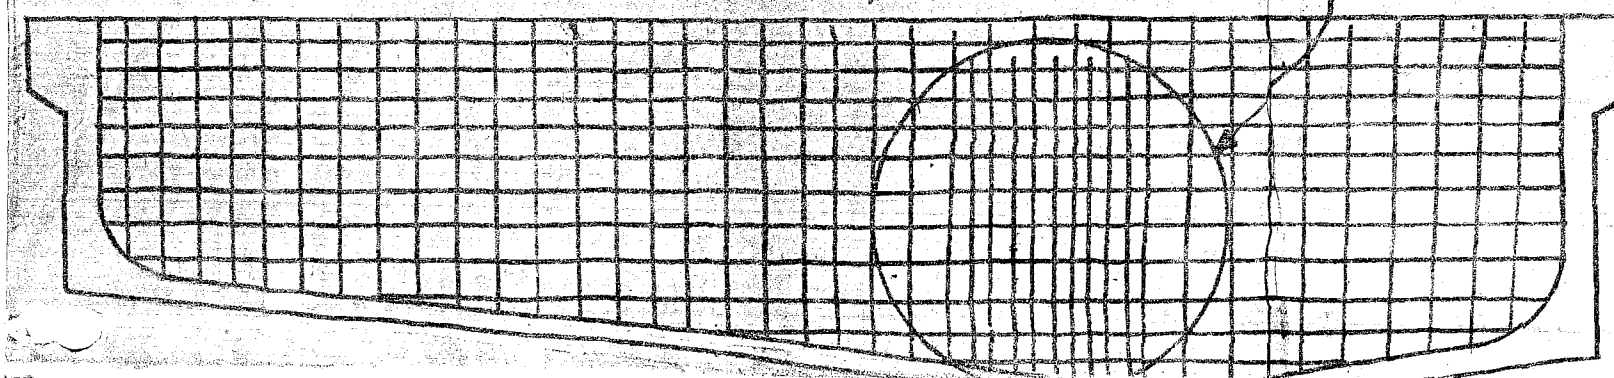

NOTES

Pools to be of sprayed ready mix concrete of 20 Mpa strength.
Concrete will be sprayed on against firm excavations.
Council to be notified for inspection prior to spraying.
Steel to overlap at joints by 40 diameters.



J035550

60mm

120mm MINIMUM


300mm

GROUND LEVEL

300mm

Stirrups 6.5mm Steel
140mm Sq @ 610mm C/S


Crosssection of Wall.

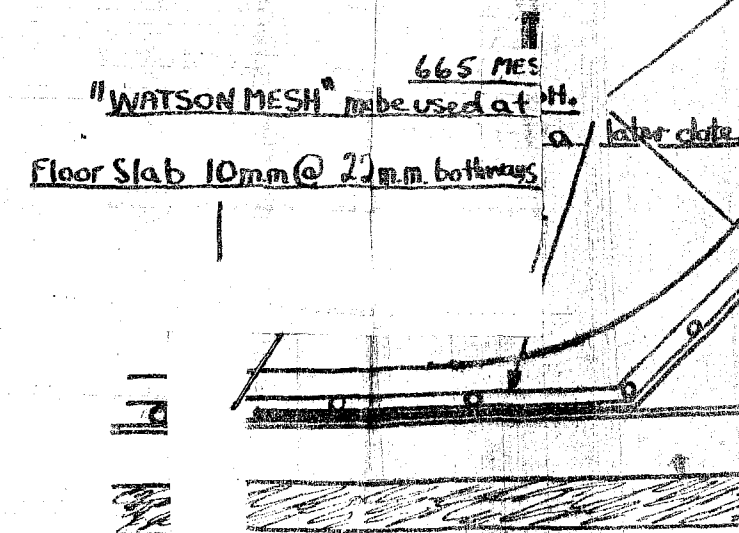

Wall 10mm @ 220mm bottomways.
If height of Wall over 1.20m.
Vertical Steel will be at 110mm C/S.


Hydrostatic Valve And Main Drain.

Installed only where water table high.

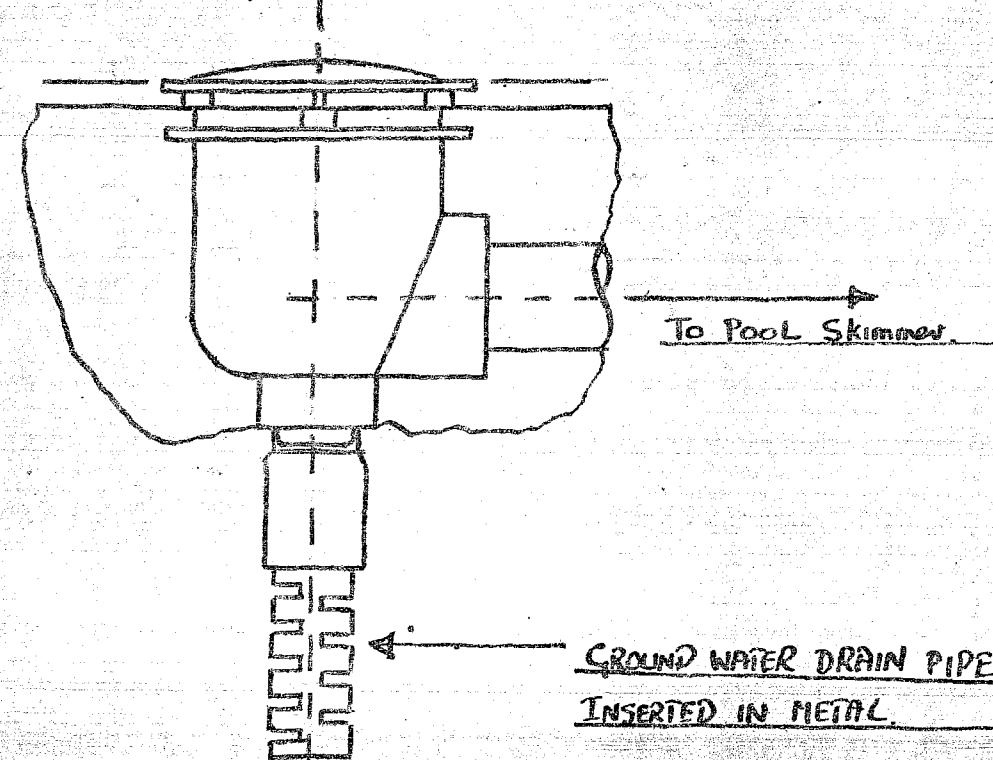

Skimmer Plan and Crosssection.

Skimmer to be of Prefabricated A.B.S. Variety.
with Internal Leaf Trap.

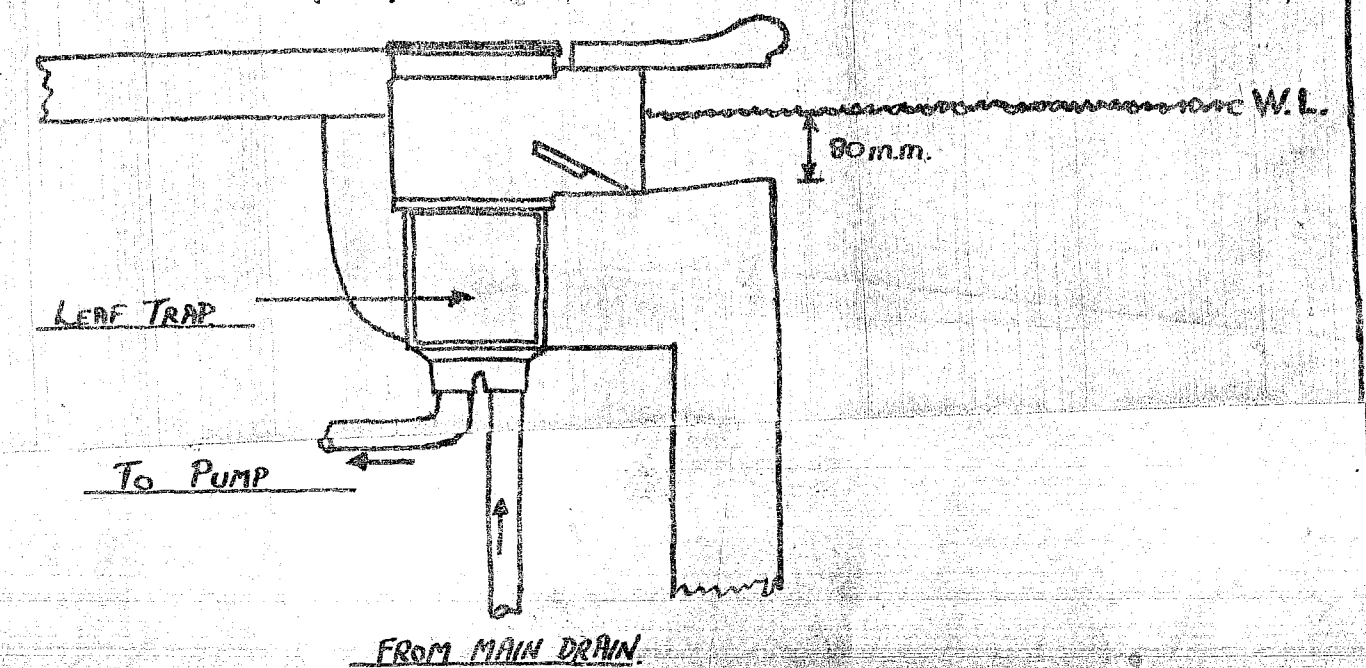

SWIMMING POOL at RESIDENCE of
Phillip & Carole Mackie.

Address 15 CARTER DRIVE
ROTORUA.

NICHOLAS CONCRETE & SWIMMING POOLS
60 HAUMOANA STREET.
ROTORUA. Tel - 79-647.

SPRAYED CONCRETE ONE PIECE POOL
SHOWING REINFORCING CROSSECTION
THROUGH WALL, MEASUREMENTS,
BOTTOM DRAIN AND SKIMMER.

NOT TO SCALE. — OCT. 75.

NOTE
Foundation excavations and reinforcing
to be inspected before any concrete is poured
24 hours before the Building Inspector
required for inspection of foundations.

LABOUR DEPT STAMP PERMITS
DO NOT RELIEVE YOU
THAT THE CHOPS & OFFICES A
FACTORY ACT AND CONSTRUCTION A

PLANS APPROVED SUBJECT TO ALL
OTHER DEPT. OF LABOUR
T.E.M.
Date 27-8-12
Inspector [Signature]

3
1
2